



ENGINEERED ELECTRONICS, INC.

LAVATORY/EMERGENCY STATION 900-119

FEATURES

- * SINGLE GANG CONSTRUCTION
- * MOUNTS WITH NO SUBASSEMBLIES
- * CALL AND RESET FROM SAME LOCATION
- * PHYSICAL AND VISUAL CALL INDICATION
- * ELECTRONIC ISOLATION
- * MINIMUM SYSTEM WIRING
- * 72 INCH CORD



GENERAL DESCRIPTION

The EEI 900-119 Lavatory-Emergency Station components are electrically isolated from the single gang plate for proper mounting into a one gang box. By gently pressing the switch or pulling the cord downward an emergency call is placed on the system using independent circuits or those of the patient station if in the same room. Cancellation of the call is always from the originating station by pressing the switch in the upward position. The call assurance LED is red and is activated when the switch is in the downward position.



ENGINEERS' SPECIFICATIONS

EEI model 900-119 is a Lavatory-Emergency station having all components mounted on a single gang plate.

1. The equipment described shall be manufactured and assembled entirely in the United States of America.
2. A mechanically locking toggle type switch is provided for placing an emergency call by gently pulling the cord or pressing the switch downward.
3. The call switch and LED assembly is electrically isolated from the face plate.
4. The call switch is provided with a 72" cord and pendant.
5. The call assurance lamp shall be a red LED.
6. The 900-103 is available with all features described less a call assurance LED.
7. A call placed from the emergency station can only be cancelled at the originating device.
8. It is possible to operate this station in conjunction with a patient, staff or other emergency stations.
9. The location of the station shall be as indicated on the plans _____ inches above the finished floor.
10. The station shall conform to Underwriters' Laboratory, Inc. listed (U.L. 1069).



WIRING DIAGRAM

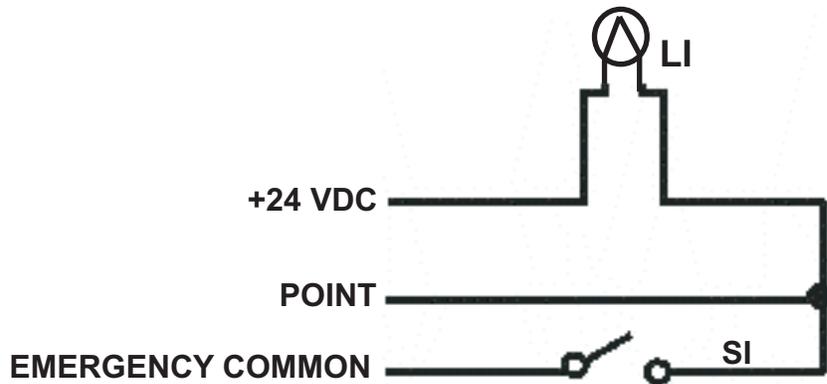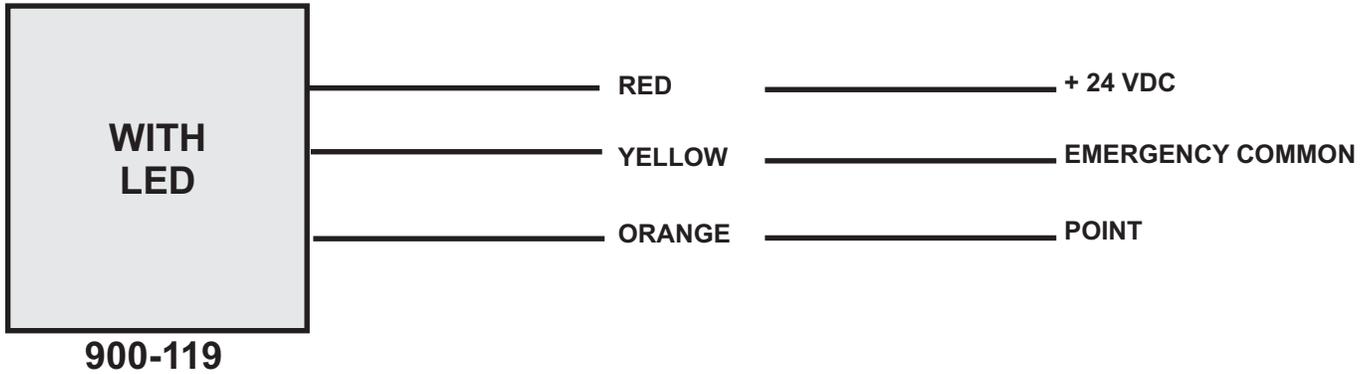

ELECTRICAL CHARACTERISTICS

24 VDC
10 MA

ACCESSORIES

100-415 RED LED
100-011 SWITCH

500-017 CORD ASSEMBLY
500-135 ALLOWS CORD TO BE
PULLED IN ANY DIRECTION

USEABLE BACK BOXES FOR NEW CONSTRUCTION

Steel City - CDLE, 58371,6060-02 or any single gang outlet box 2 1/2 inches deep with a minimum of 12.5 cubic inch capacity.