


REFER TO DRAWING 201-101 FOR  
LOCATION OF TERMINATING POINTS

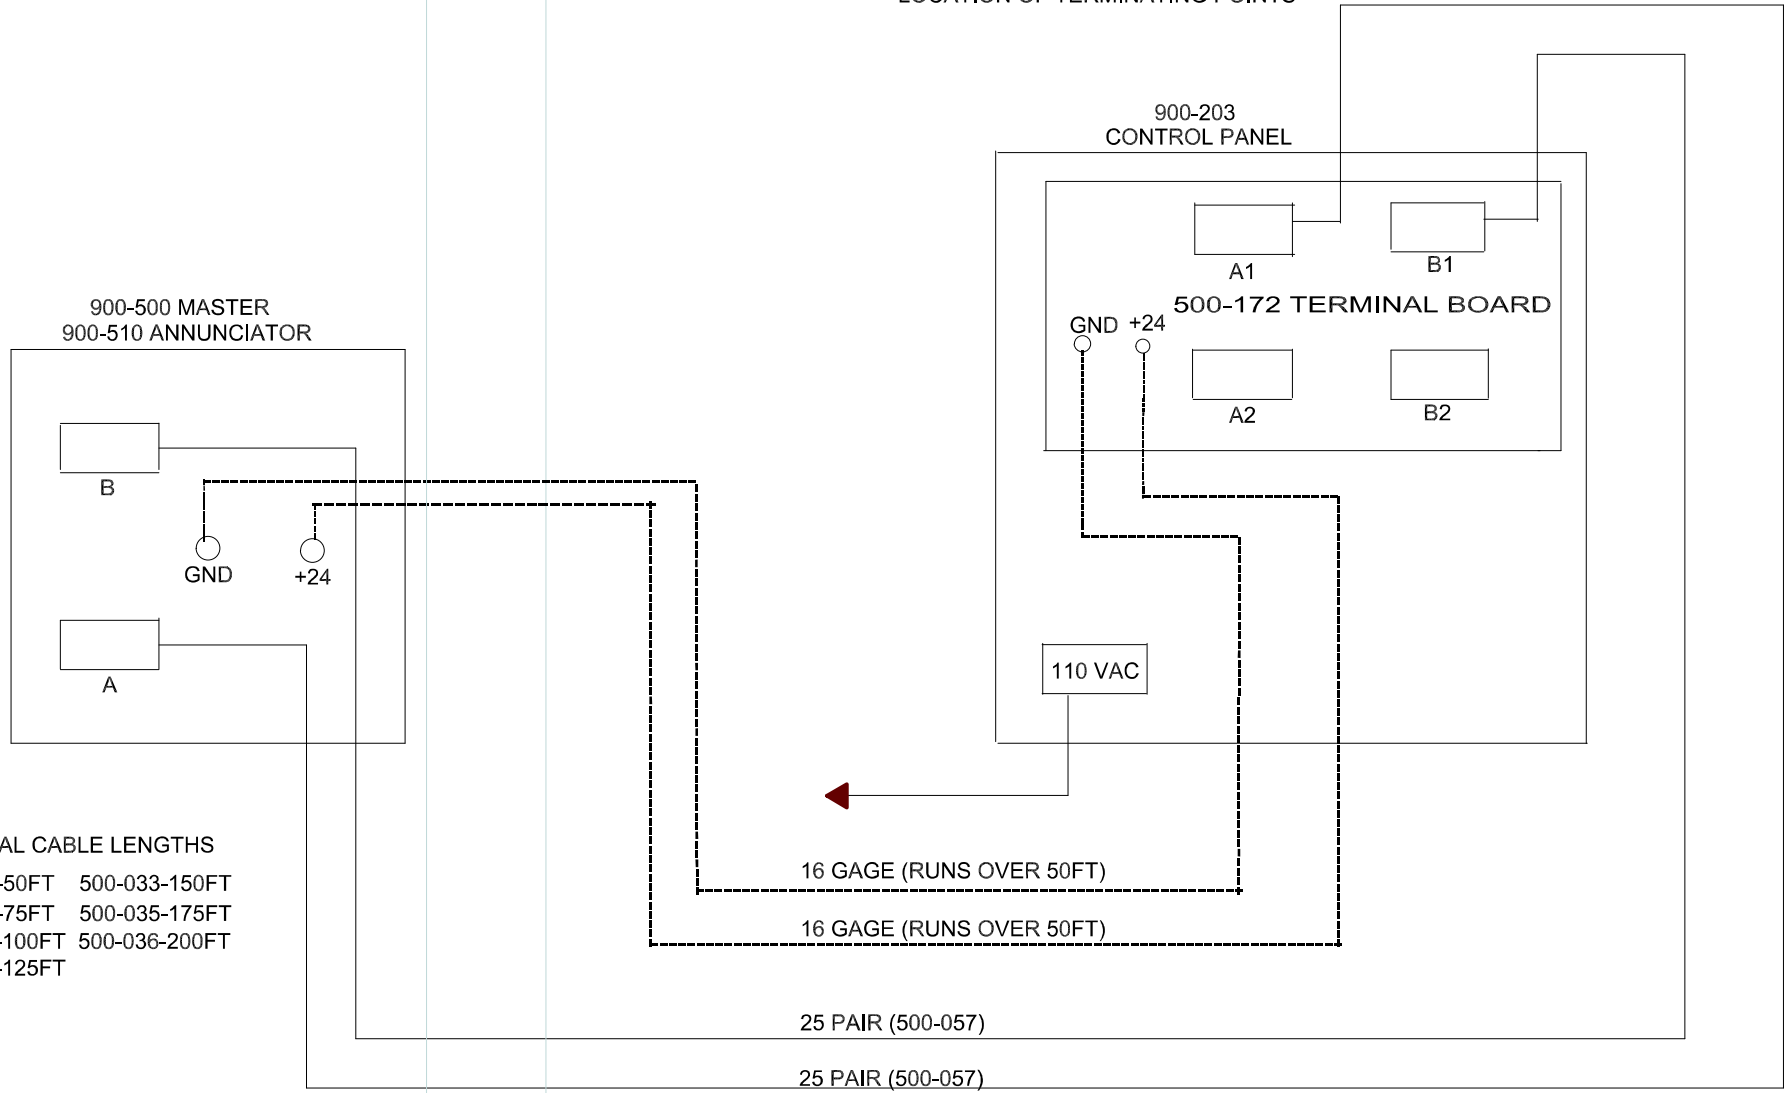

OPTIONAL CABLE LENGTHS

- 500-027-50FT 500-033-150FT
- 500-028-75FT 500-035-175FT
- 500-029-100FT 500-036-200FT
- 500-030-125FT

NOTES!

- 110 VAC POWER FEED MUST COME IN BOTTOM LEFT OF CONTROL CABINET
- ALL FIELD WIRING SHOULD COME IN TOP OF CONTROL CABINET
- MINIMUM OF 1 1/4 INCH CONDUIT REQUIRED BETWEEN MASTER / ANNUNCIATOR AND CONTROL
- TWO (2) CONDUCTOR 16 GAGE REQUIRED FOR RUNS OVER 50FT

TWO (2) 500-057 INTERCONNECT CABLES 25FT LONG ARE SUPPLIED WITH MASTER/ANNUNCIATOR  
SEE OPTIONAL CABLES FOR DIFFERENT LENGTHS

**Engineered Electronics, Inc**  
4301 Industrial Access Road  
Douglasville, Ga. 30134

TITLE **CABLE WIRING BETWEEN  
MASTER / ANNUNCIATOR AND CONTROL**

SIZE <b>A</b>	DRAWING NO. <b>102-007</b>	REV
SCALE	DATE 4-10-02	